


NOTE: THE BACTERIOLOGICAL WATER TEST LINE SHALL BE REMOVED ONCE SATISFACTORY WATER QUALITY TESTS ARE ACHIEVED BY THE CONTRACTOR. THE LINE SHALL BE PLUGGED AT THE HYDRANT LEAD.

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED
SEE DRAWING A-1633 FOR HYDRANT AND VALVE INSTALLATION DETAILS

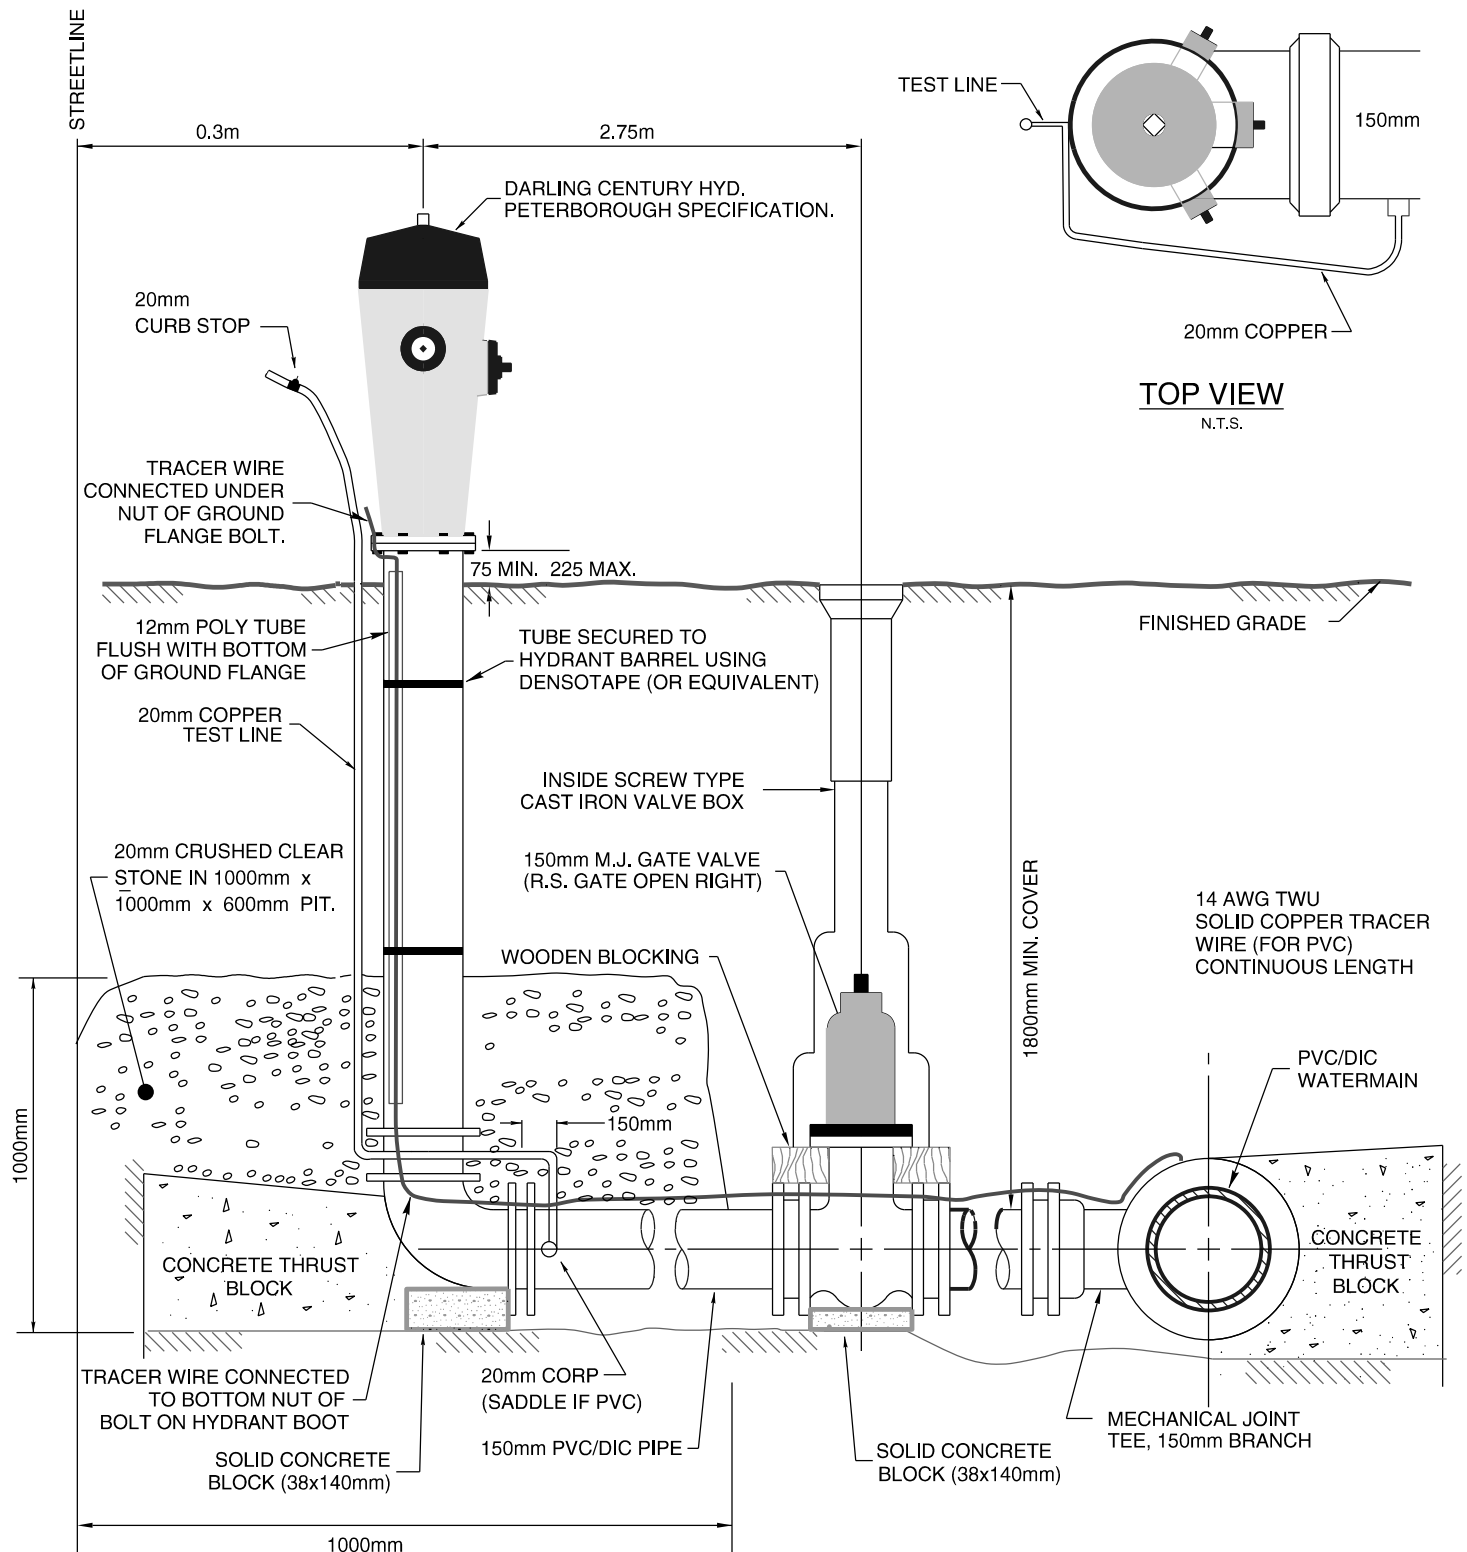

PETERBOROUGH UTILITIES SERVICES INCORPORATED

TITLE		No.	REVISION	DATE
HYDRANT BRANCH BACTERIOLOGICAL WATER TEST LINE		1.	BACT. TEST LINE REMOVAL	01 AUG. 2001
		2.	REVISE NOTES	31 AUG. 2005
DRAWN BY <i>Steve Bilinger</i>	SCALE N.T.S.	DRAWING No. CADD A1754		
DESIGNED	JOB COST			
APPROVED <i>[Signature]</i>	DATE 31 AUG. 2005			