


N.T.S.

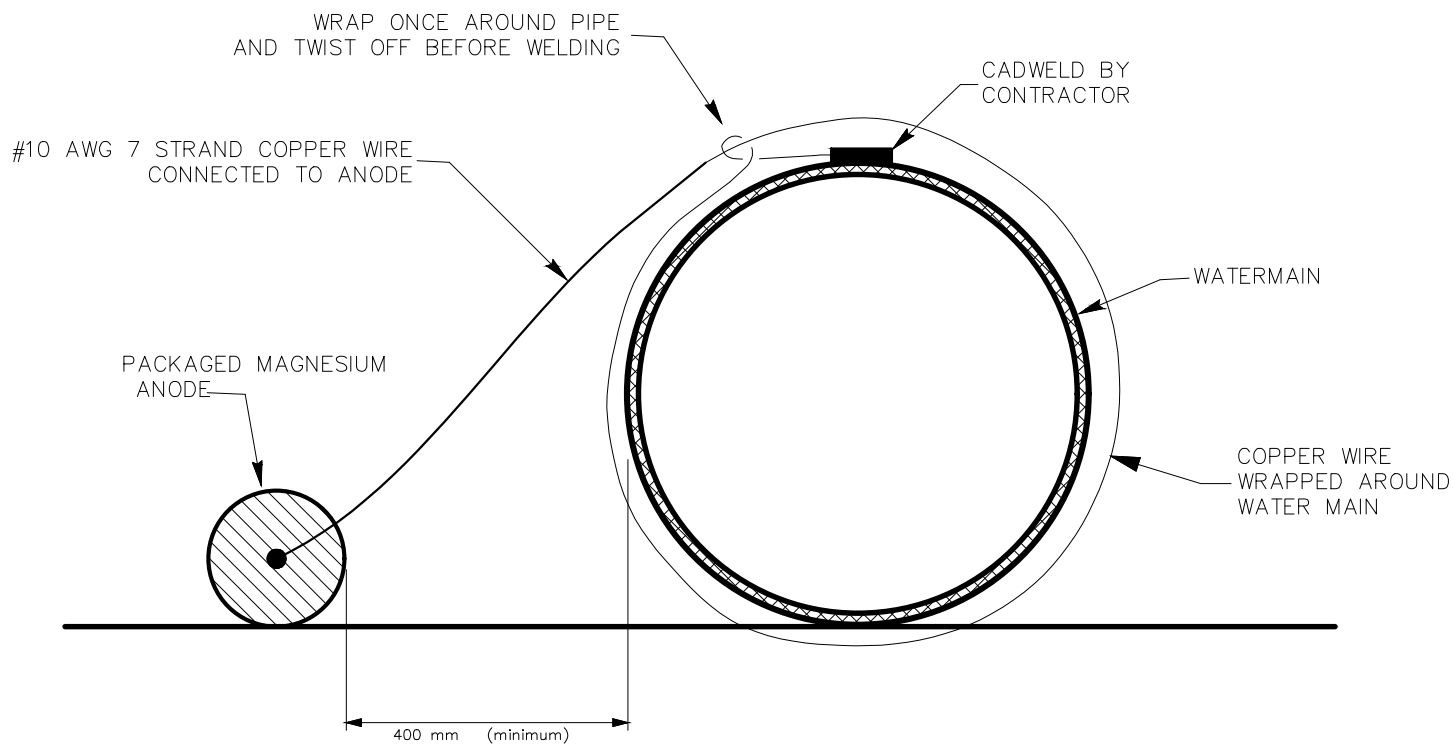


NOTES:

- 1) Contractor shall use proper mould and cartridges for the cadweld. (configuration of mould varies with pipe diameter)
- 2) The pipe surface at the point of weld must be scraped clean of bituminous coating to provide a good clean contact.
- 3) After the weld is completed, a thick coating of T.C. Mastic (Tapecoat of Canada) must be applied, by brush, to all exposed metal at the weld.
- 4) Packaged magnesium anode specifications are in approved material list and shall be spaced in accordance with P.U.C. specifications.

PETERBOROUGH UTILITIES COMMISSION

STANDARD WATERWORKS DRAWING

	TITLE	No.	REVISION	DATE
	DETAIL FOR CONNECTING ANODES TO CAST IRON AND DUCTILE IRON WATERMAINS	1.	UPDATED TITLE BLOCK	07-27-2023
		2.		
DRAWN BY: S. BILLINGS	APPROVED: K. CONLIN	A2370		
DESIGNED: K. CONLIN	DATE: 04-19-2011			