


NOTES

1. SERVICE BOX AND SAMPLE STATION TO BE INSTALLED IN VERTICAL POSITION WITH TOP OF SERVICE BOX FLUSH WITH FINISHED GRADE.
2. BOX AND SAMPLING STATION TO BE ADEQUATELY BRACED DURING BACKFILLING.
3. SAMPLING STATION SHALL BE LOCATED ON STREET LINE OR UP TO 300mm TOWARDS CURB, BUT SHALL NOT BE LOCATED ON PRIVATE PROPERTY.
4. 50mm SM INSULATION TO BE INSTALLED AS ILLUSTRATED.
5. ALL SERVICES TO BE INSTALLED AT RIGHT ANGLES TO THE MAIN UNLESS APPROVED OTHERWISE.
6. UNIONS ARE NOT ALLOWED ON THIS INSTALLATION.
7. WHERE GROUND CONDITIONS DO NOT PROVIDE A SOLID BASE, A 50 mm x 150 mm PRESSURE TREATED WOODEN BLOCK (OR PUC APPROVED EQUIVALENT) SHALL BE USED TO SUPPORT THE CURB STOP.
8. DUCTILE IRON PIPE TO BE TAPPED FOR SERVICE CONNECTION USING AWWA C-800 CORPORATION STOP.
9. WATER SERVICES INSTALLED ON PVC PIPE SHALL BE EQUIPPED WITH SERVICE SADDLES AND ZINC ANODE.
10. SAMPLING STATION TO BE EQUIPPED WITH 100mm VERTICAL CASING PIPE, FILLED WITH SAND AND EQUIPPED WITH A HEAT TRACE CABLE.
11. LOCATION OF SAMPLING STATION TO BE APPROVED BY THE P.U.C. PRIOR TO INSTALLATION.

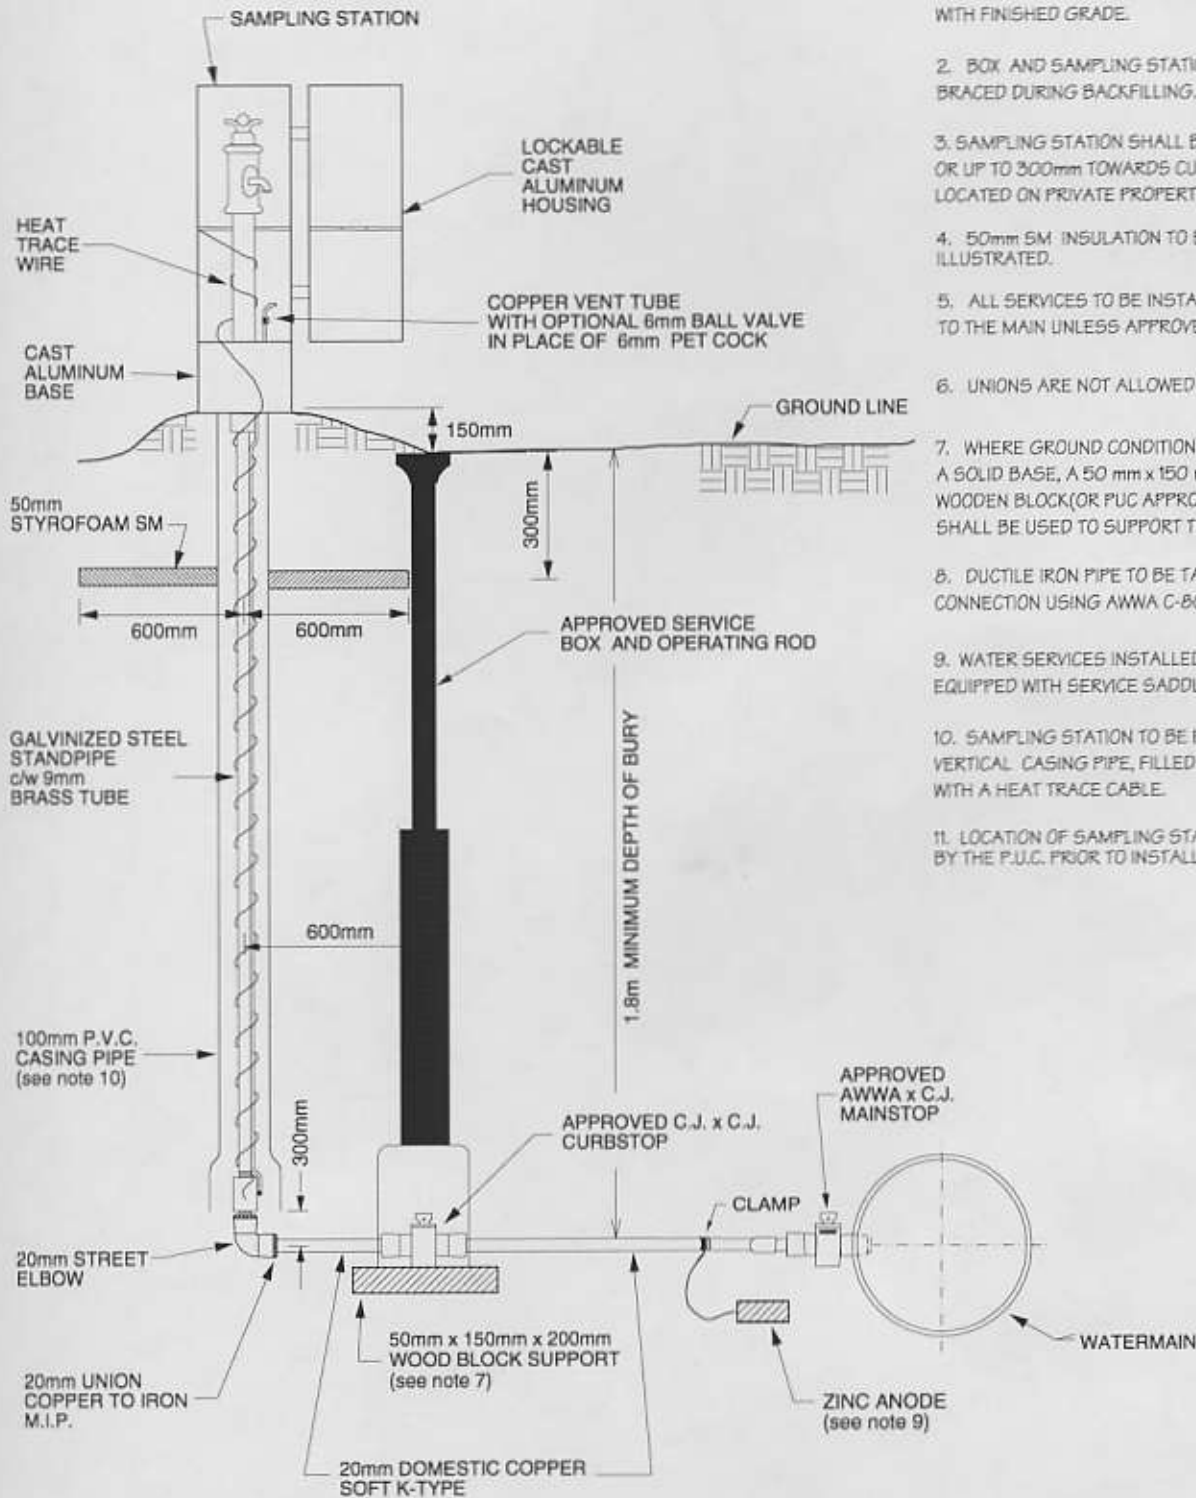

PETERBOROUGH UTILITIES SERVICES INCORPORATED

TITLE	WATER SAMPLING STATION	No.	REVISION	DATE
		1.		
2.				
DRAWN BY <i>Steve Billing</i>	SCALE NOT TO SCALE	DRAWING No.		
DESIGNED <i>[Signature]</i>	JOB COST	CADD A2421		
APPROVED <i>[Signature]</i>	DATE 16 JAN. 2001			