



FLANGE JOINT

**UNI-FLANGE SERIES 900
RESTRAINER OR APPROVED
EQUIVALENT**

100 mm TO 300 mm

NOTE:

ANY CONNECTION TO OTHER
FLANGED PIPE REQUIRES AN
ADDITIONAL RESTRAINER TO
THE W/M PIPE.

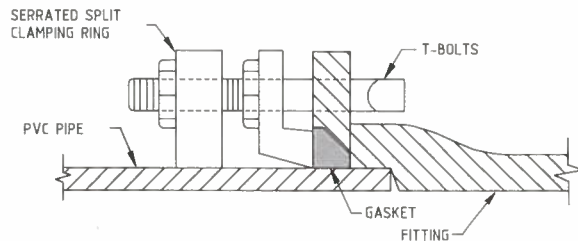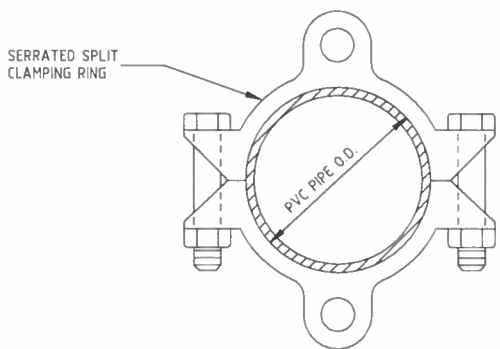


MECHANICAL JOINT

**UNI-FLANGE SERIES 1300
RESTRAINER OR APPROVED
EQUIVALENT**

100 mm TO 300 mm

NOTES:

1. ALL BOLTS AND NUTS SHALL BE CORE-TEN STEEL OR EQUIVALENT.
2. REFER TO STANDARD DWG. A2731 FOR LENGTH OF JOINTS TO BE RESTRAINED.
3. ONE 7.7kg MAGNESIUM ANODE IS TO BE INSTALLED ON EACH RESTRAINER.
4. ANODE WIRE TO BE FASTENED TO RESTRAINER UNDER A NUT ON THE RESTRAINER
5. MINIMUM HORIZONTAL DISTANCE BETWEEN ANODES 1.0 m.

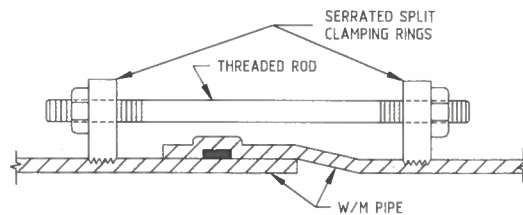

BELL JOINT

**UNI-FLANGE SERIES 1350
RESTRAINER OR APPROVED
EQUIVALENT**

100 mm TO 300 mm

ALL DIMENSIONS IN MILLIMETERS EXCEPT WHERE NOTED.

PETERBOROUGH UTILITIES COMMISSION

TITLE	RESTRAINED JOINT DETAIL FOR P.V.C. PIPE	No.	REVISION	DATE
		1.		
DRAWN BY	<i>[Signature]</i>	SCALE	NOT TO SCALE	2.
DESIGNED	<i>[Signature]</i>	JOB COST		DRAWING No.
APPROVED	<i>[Signature]</i>	DATE	MARCH 29, 2011	CADD
				A2730