


**FOR MAINTENANCE ONLY  
(UNDER DIRECT SUPERVISION OF PUC LICENSED OPERATOR)**

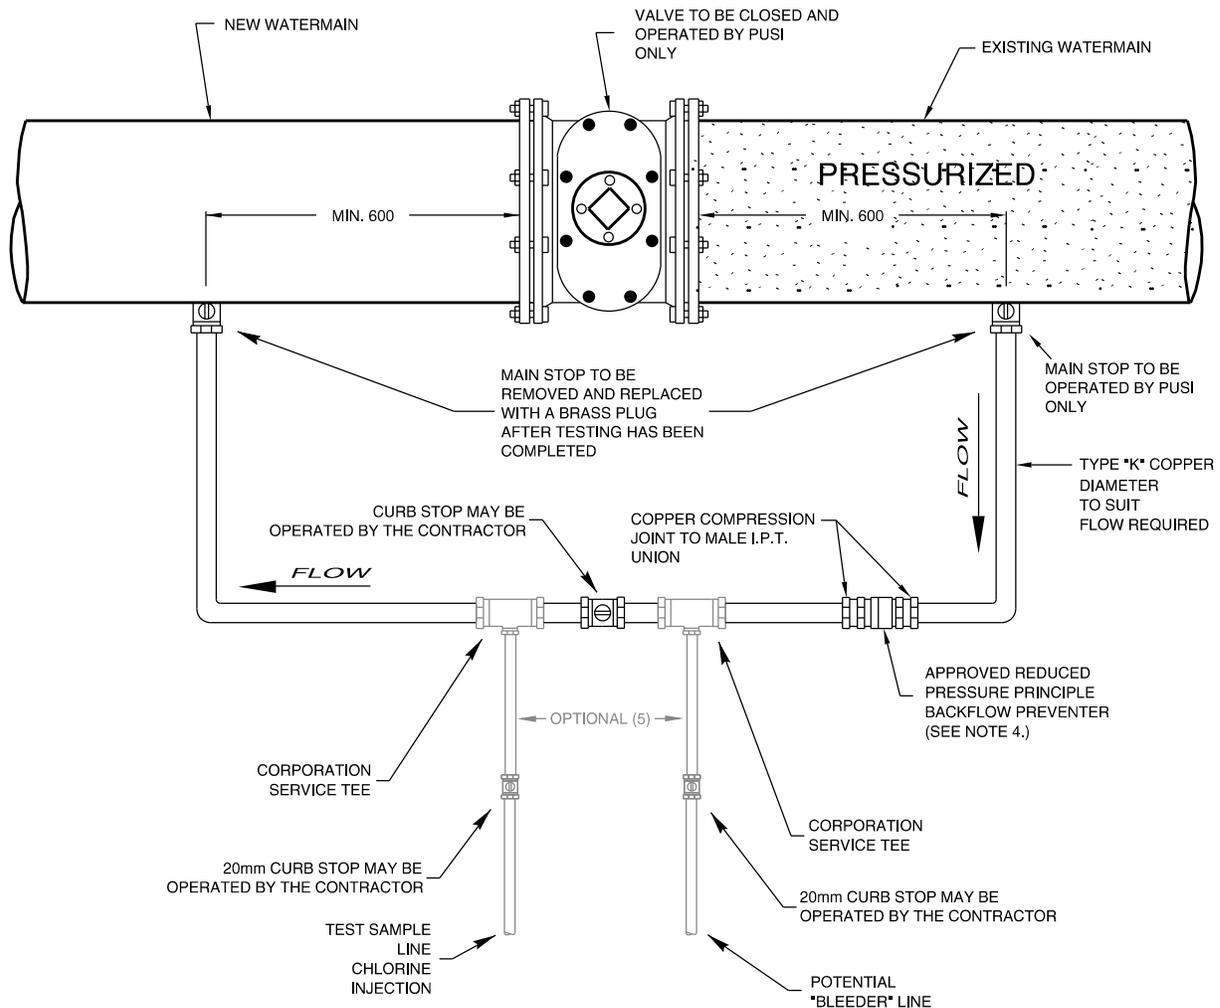

**SUPERCEDES**  
DRAWING A2458

**NOTES:**

1. TRENCH TO BE LEFT OPEN AND FENCED IN ACCORDANCE WITH SAFETY REGULATIONS
2. INSULATION OF WATERMAIN BY-PASS MAYBE REQUIRED DURING FREEZING CONDITIONS
3. ACCEPTABLE FOR NEW WATERMAIN INSTALLATIONS UP TO AND INCLUDING 300mm DIAMETER
4. APPROVED BACKFLOW PREVENTERS AS PER THE "APPROVED MANUFACTURERS' PRODUCTS FOR THE PETERBOROUGH WATER SYSTEM"
5. CAN COMBINE CHLORINATION AND BACTERIOLOGICAL TEST POINT BYPASS

**PETERBOROUGH UTILITIES COMMISSION**

TITLE		No.	REVISION	DATE
POTABLE WATER SUPPLY FOR TESTING CEMENT LINED WATERMAIN. CHLORINATION AND BACTERIOLOGICAL TEST POINT BYPASS.		1.	Added "For Maintenance" Note	Feb 12, 2019
DRAWN BY	<i>Steve Billings</i>	2.		
DESIGNED	<i>Steve Billings</i>	DRAWING No.		
APPROVED	<i>[Signature]</i>	DATE	February 12, 2019	
		<b>CADD A3004</b>		