


**FOR MAINTENANCE ONLY
(UNDER DIRECT SUPERVISION OF PUC LICENSED OPERATOR)**

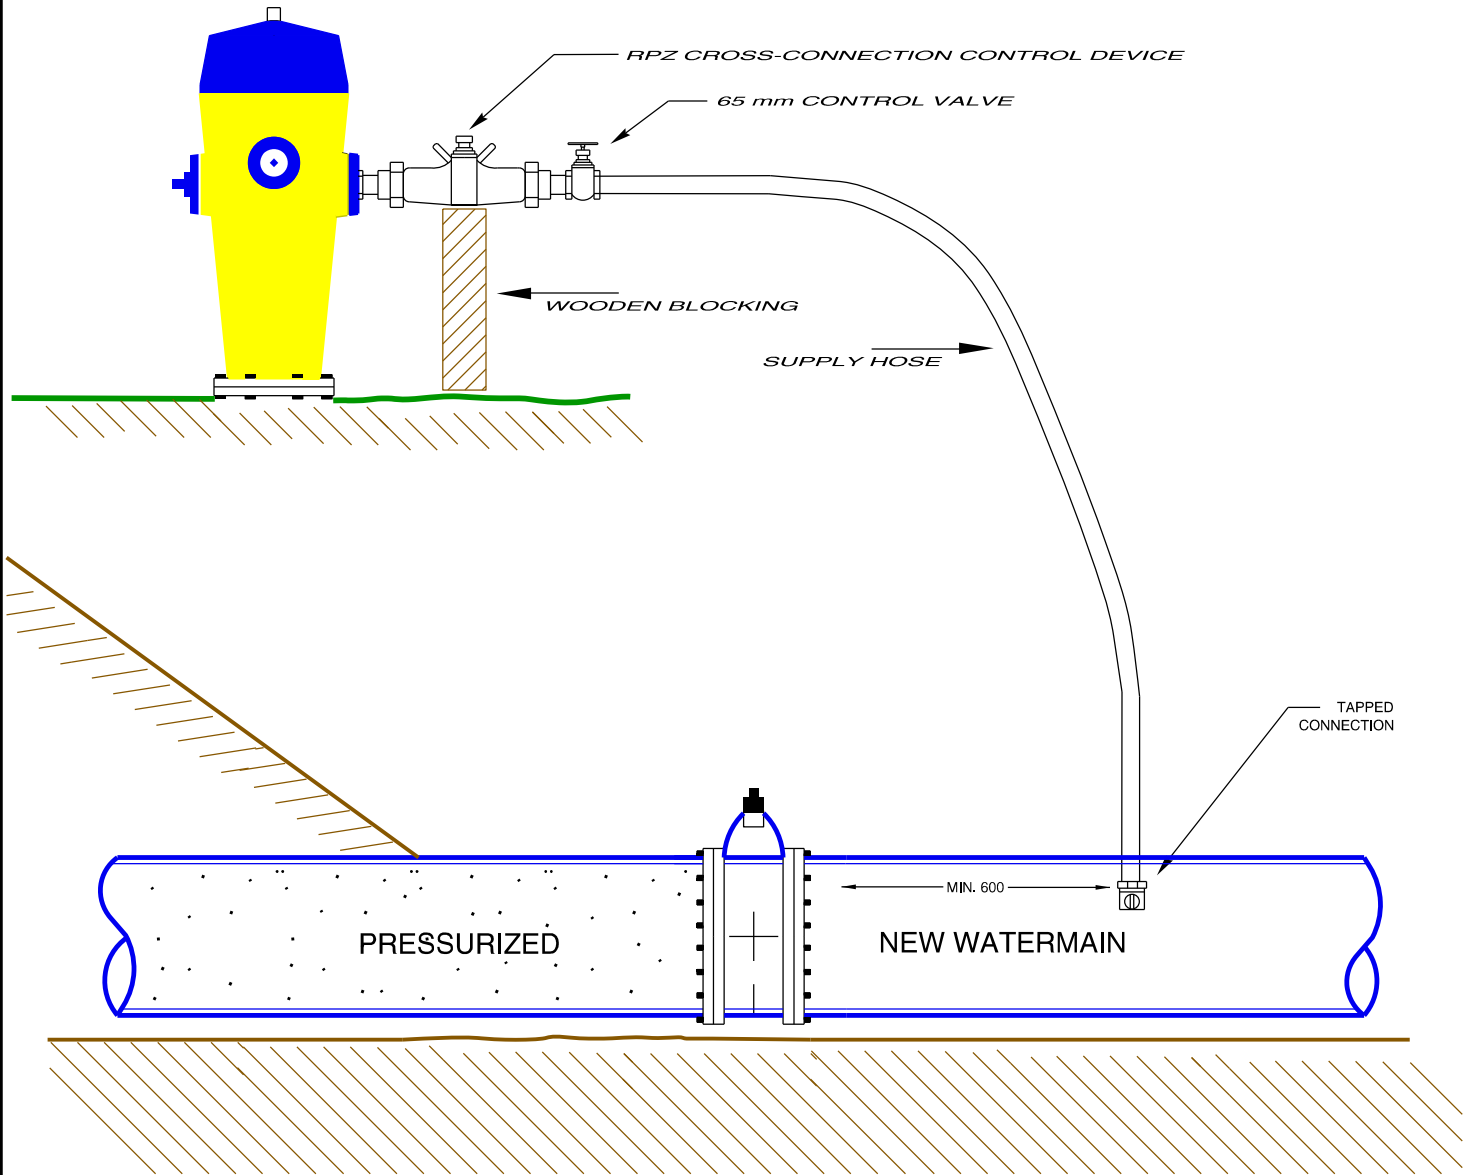

NOTES:

1. FOR CONNECTION TO THE MAIN REFER TO: A1636 FOR 20-25 mm & A2269 FOR 38-50 mm
2. HYDRANT CONNECTION TO BE REMOVED FOLLOWING CHLORINATION OR AT ANY TIME A PUC LICENSED OPERATOR IS NOT PRESENT

PETERBOROUGH UTILITIES COMMISSION

TITLE	ALTERNATIVE POTABLE WATER SUPPLY FOR TESTING CEMENT LINED WATERMAIN	No.	REVISION	DATE
		1.	Added "For Maintenance" Note	Feb 12, 2019
DRAWN BY	Steve Billings	SCALE	NTS	
DESIGNED	Steve Billings	JOB COST		DRAWING No.
APPROVED		DATE	FEBRUARY 12, 2019	CADD A3005