


NOTE:
DISCHARGE TO STORM SEWER
MAY BE PERMITTED PENDING
PUC APPROVAL OF DECHLORINATION METHOD

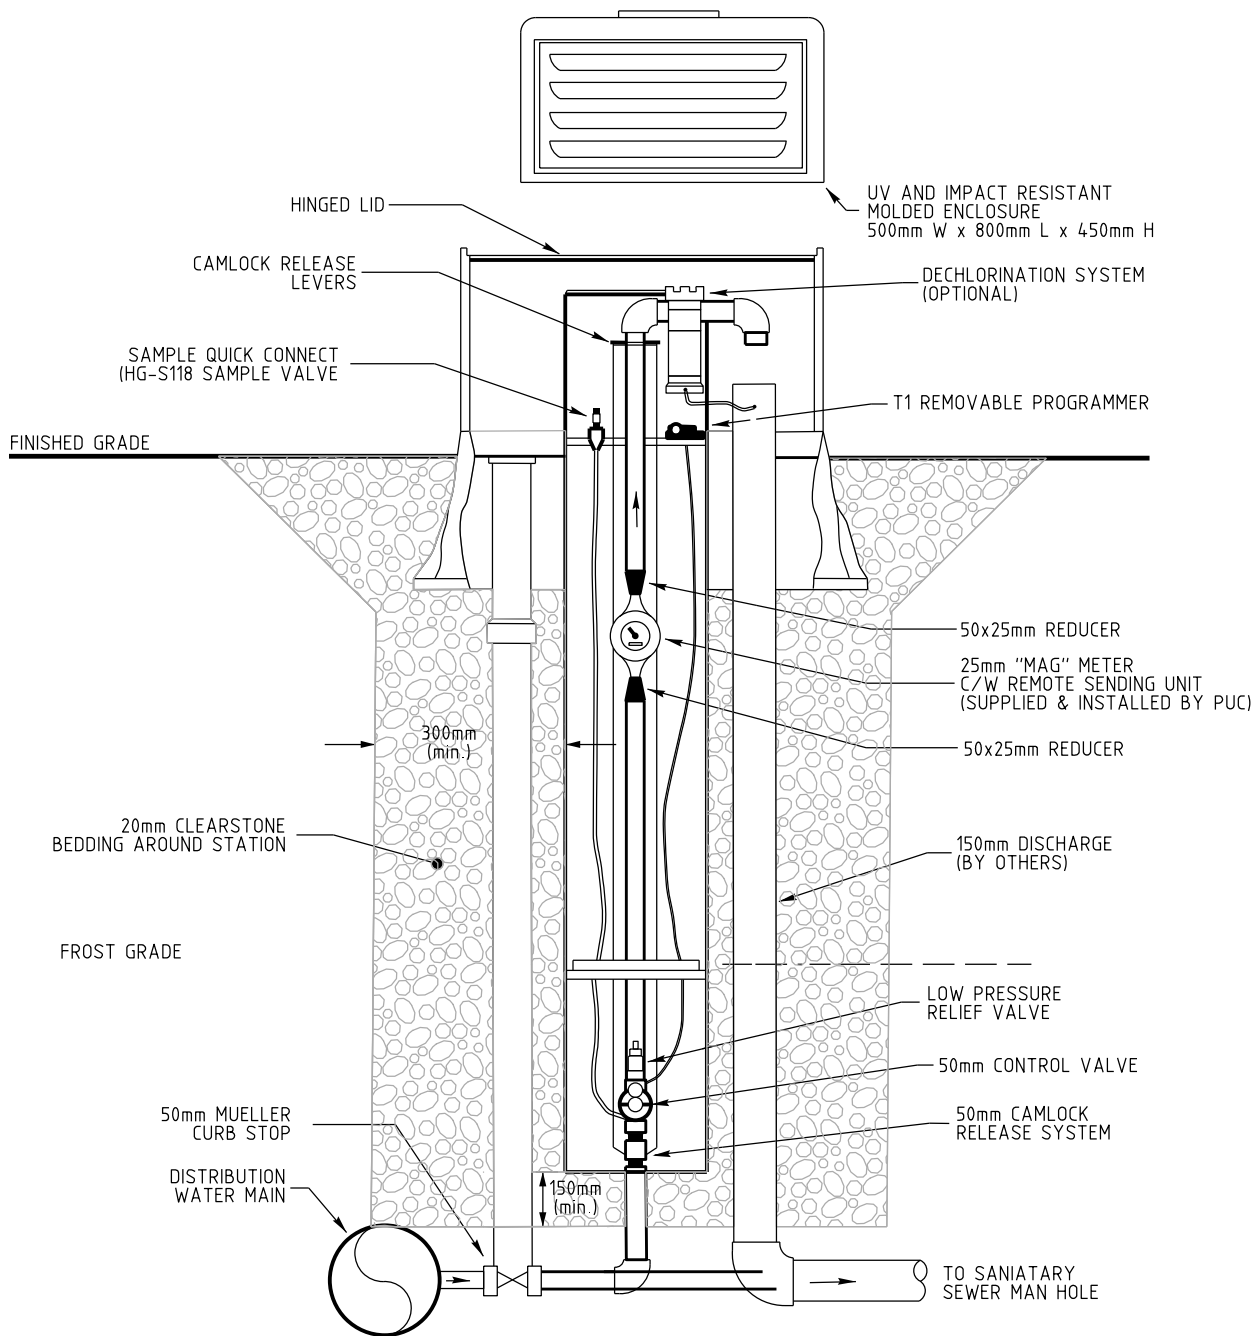

PETERBOROUGH UTILITIES COMMISSION

TITLE		No.	REVISION	DATE
MUELLER Co. HYDRO GUARD HG4 AUTOMATED FLUSHING STATION® INSTALLATION		1.	Add 20mm stone backfill	Dec. 21, 2017
		2.	Mag Meter Information	Feb. 27, 2018
		3.	Move Valve Location	Jan 14, 2019
DRAWN BY	<i>Steve Billings</i>	SCALE	NOT TO SCALE	
APPROVED	<i>[Signature]</i>	JOB COST	DRAWING No.	
		DATE	CADD	
		JANUARY 14, 2019	A3073	